


- CONCRETE NOTES:
1. CONCRETE SLAB SHALL BE MINIMUM 4" THICKNESS.
 2. ALL REBAR SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 2500 PSI AT 28 DAYS.
 3. FOUR REBAR SHALL BE USED AGAINST UNDISTURBED NATURAL SOIL.
 - SB = 1000 PSF
 - ACTIVE = 30 PSF
 - PASSIVE = 300 PSF
 4. COEFFICIENT OF FRICTION = 0.4
 5. REBAR SHALL BE ONE HALF PART LINE PUTTY, FOUR AND ONE HALF PARTS SAND. SHALL CONFORM TO ASTM A615. IF PLASTIC CEMENT IS USED, LINE PUTTY SHALL BE OMITTED.
 6. REINFORCING STEEL SHALL BE DEFORMED BARS CONFORMING TO ASTM A615.
 7. PROVIDE 60 LAP 60 BAR DIAMETERS U.N.O.
 8. PROVIDE MINIMUM 6" MINIMUM RIGID HIGH DENSITY FOAM DIRECTLY BELOW CONCRETE. PROVIDE MINIMUM 6" MINIMUM RIGID HIGH DENSITY FOAM INSULATION.
 9. SOIL BELOW TO BE VIRGIN OR MECHANICALLY TAMPED.
 10. ALL CONTINUOUS STRIP FOOTINGS TO HAVE TWO #4 REBAR CONTINUOUS.
 11. ALL PAD FOOTINGS TO HAVE #4 REBAR @ 9" O.C. EACH WAY, MAINTAIN 3" SEPARATION W/ EDGES.

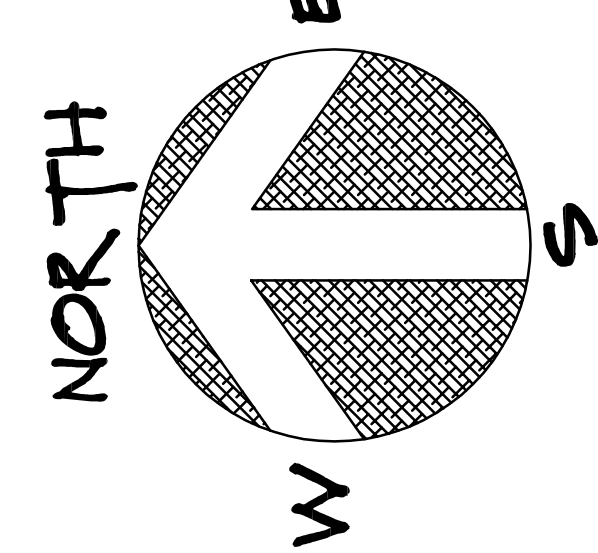

MODEL 2800 MID PROFILE
60 DIAMETER

FOUNDATION PLAN
SCALE 1/4" = 1'-0"

JOY & KIRK BINGHAM
410 ARTIST AVE.
ENGLEWOOD, FL

DESIGN & INFORMATION © 2008 BY
NATURAL SPACES DOMES
9795 BRIDGE RD. NORTH BRANCH, MN 55056 651-714-4292 + 800-793-7107
WWW.NATURALSPACESDOMES.COM

BY	DATE	BY	DATE
NJH	11/18/07		
NJH	2/29/08		
BJC	4/07/08		
BJC	4/14/08		
BJC	4/15/08		
BJC	4/23/08		

SHEET
8
11/18/07